



# NC-EPS

## Nurse Call Emergency Pull Station



UL 1069 and CSA C22.2#205  
5002971

The Tech Works **NC-EPS** is an Emergency Pull Station in a semi-flush ABS plastic enclosure for durable emergency signaling. A braided nylon pull cord provides the patient with call-for-help access when they may not be able to reach the station. A convenient Push for Help button is also included for activating the Call. The Pull Cord is a 42 inch "Hygenicord" for easy sterilization. Staff is provided with a distinctive "CANCEL" button to reset the station.

An integral call confirmation LED notifies the user that a call for help has been sent. The Call Assurance Light will be Off if no call is pending, glowing steadily if a Normal Call is pending, and flashing if an Emergency Call is Pending.

This is a passive button-and-light assembly designed for use with active stations like the **NC-DL-12-R** Dome Light. Screw Terminals provide wiring connection to the active electronic stations that provide signaling and control for the **NC-EPS**.

The **NC-EPS** is also available with foam gasket (**-WP**) on the back to seal it to a wall when installed in high moisture environments. The **NC-EPS-WP** is for use adjacent to areas like showers but is not intended for submersion in water.

Mounting is a standard 1-gang electrical box. An integral back plate provides mounting and adaptor alignment for the **NC-EPS**.

### BENEFITS

- Reliable Signaling
- No Maintenance
- Low Power
- Simple Wiring
- Easily Integrates to other Systems
- Hygenicord, Bio-Safe, Cleanable Cord

### Associated Equipment

**NC-DL-12** Dome Light

### Design Information

**Power** 15V DC  
**Color** White  
**Mounting** 1 Gang Back Box  
**Dimensions** 3.25" W x 0.5" D x 5" H  
**Weight** 0.25 lbs.

### Architects' and Engineers' Specifications

The Nurse Call System Emergency Pull Station shall be a standard one gang electrical box mounting device constructed of ABS plastic. A large push for Help button shall be included with a durable Hygenicord bio-safe cord to provide both push and pull for help operation. A distinctive Cancel button shall be provided to reset the station. A call confirmation light shall be included to indicate that a call has been placed. The pull station shall be a passive electronic device requiring no more than 3 mA at 15 Volts DC for full operation.

The Nurse Call System Emergency Pull Station shall be Tech Works Model NC-EPS.




# Tech Works®

"Making Specialized Communication Easy"



## Quick Start Installation Instructions

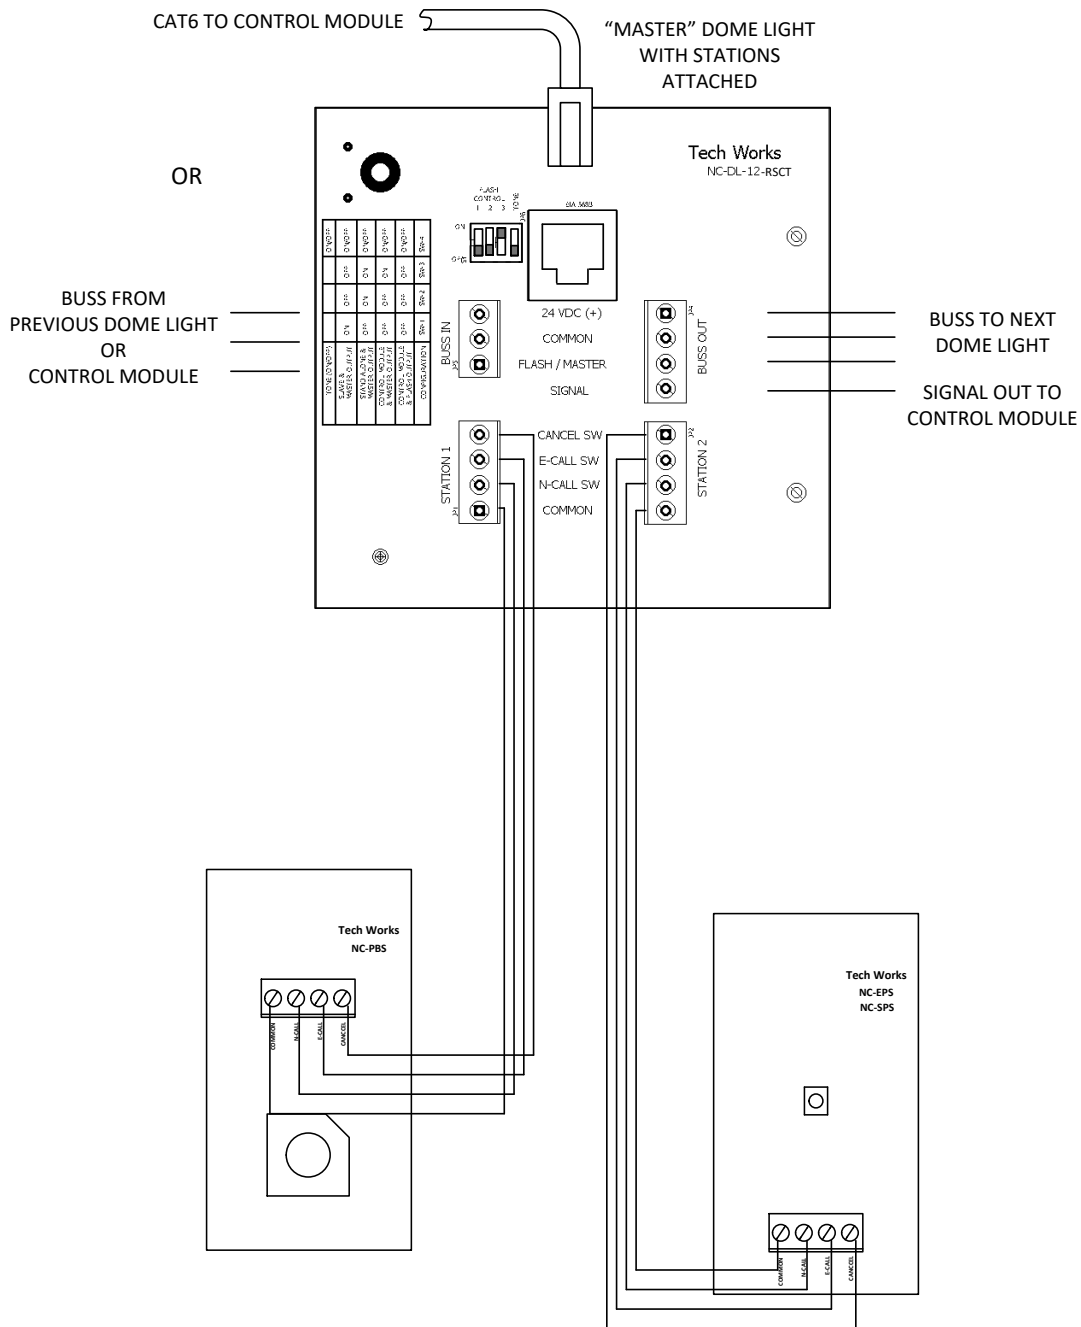

For further system set up and adjustment please see the System Planning Guide by scanning the QR Code.

